



REVISION				
REV.	ECO	DESCRIPTION	INIT	DATE
A		ENGINEERING RELEASE	SPJ	02/17/2017

DETAILS



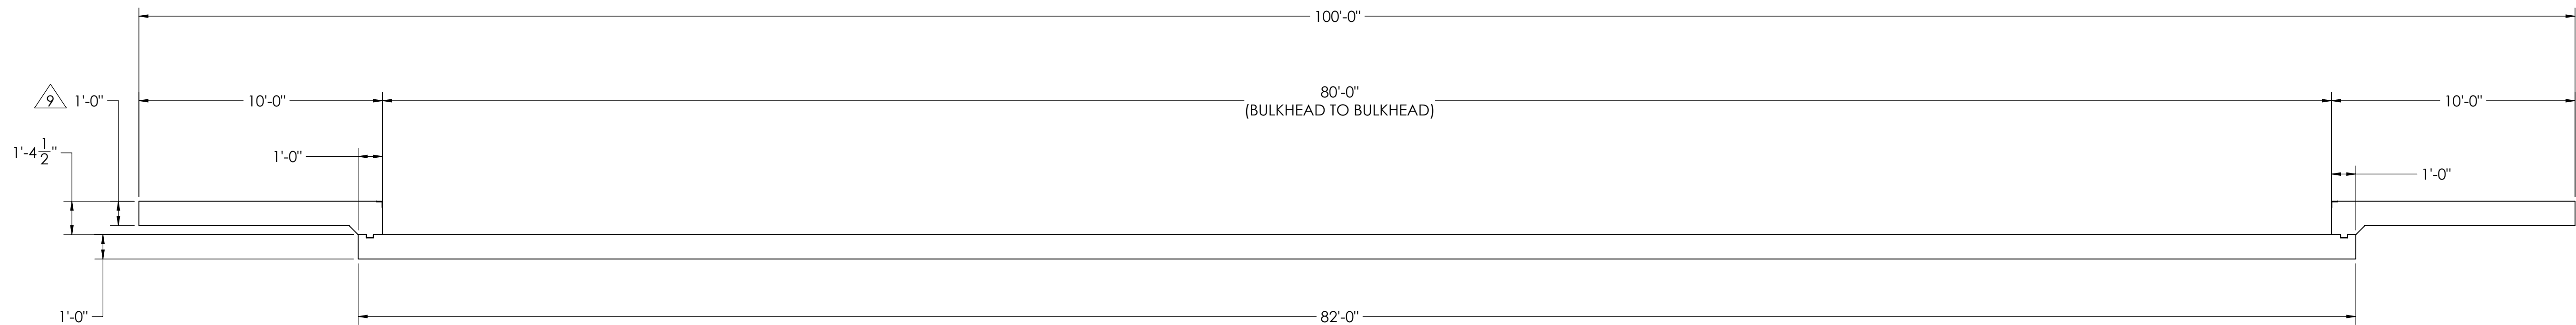

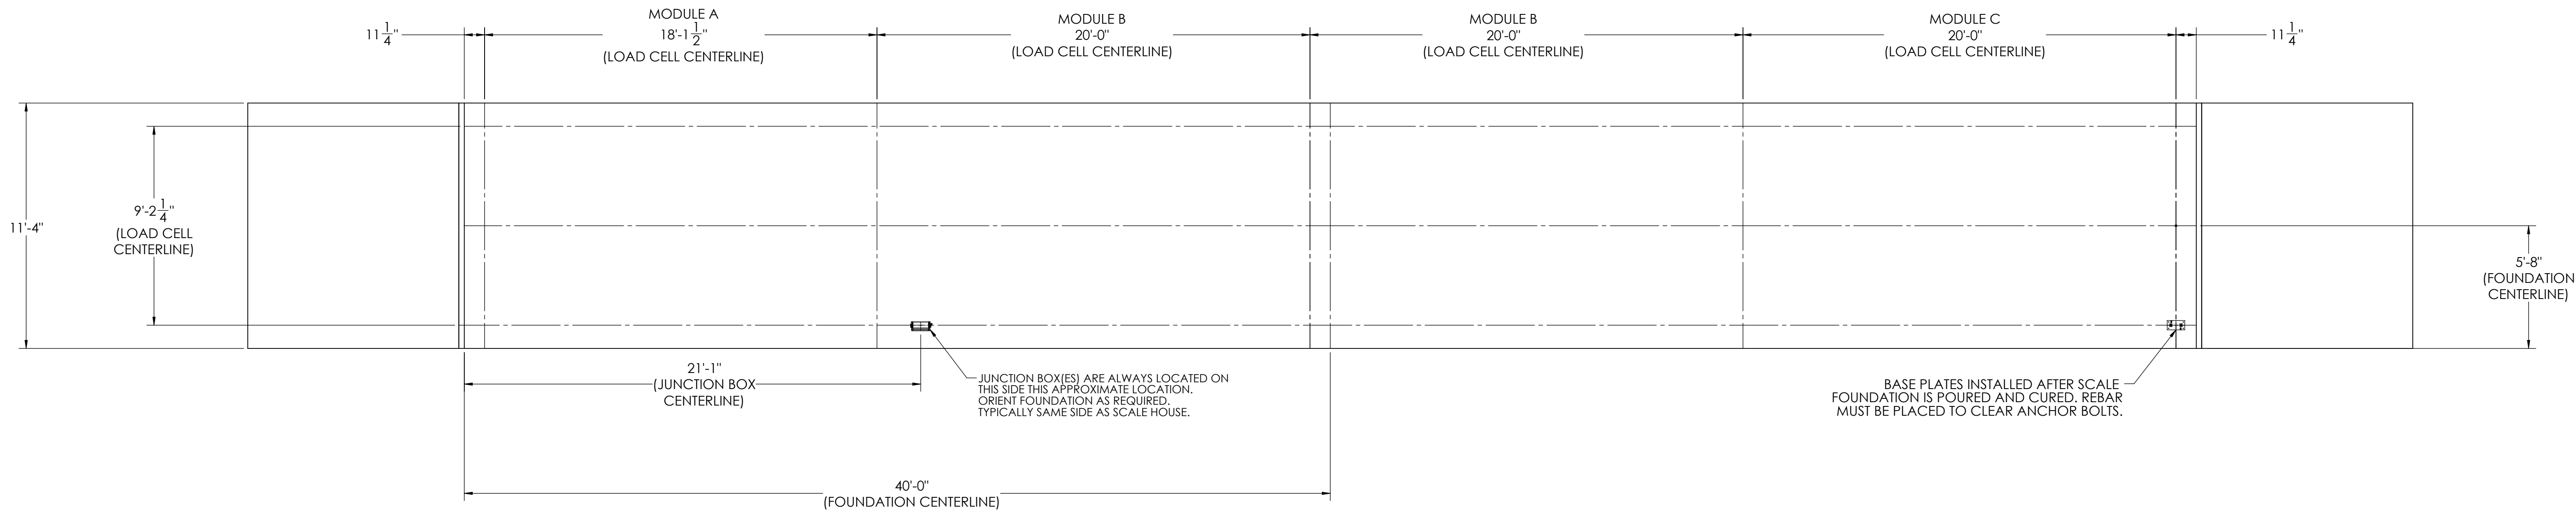

NOTES:

- 1) CONCRETE: $f'c = 3000 \text{ PSI}$ @ 28 DAYS.
- 2) REINFORCING STEEL: DEFORMED BARS ASTM A615 GRADE 60.
- 3) STATE AND LOCAL AGENCIES MAY HAVE VARIOUS REQUIREMENTS FOR APPROACH RAMP LENGTH, PITCH, AND FOR CLEAN OUT HEIGHT. PLEASE CHECK WITH ALL AGENCIES PRIOR TO CONSTRUCTION.
- 4) MONOLITHIC POUR OF SLAB AND APPROACHES IS ALLOWED, AT CONTRACTOR'S DISCRETION.
- 5) DEVELOP AND MAINTAIN SITE GRADES WHICH WILL RAPIDLY DRAIN SURFACE AND ROOF RUN-OFF AWAY FROM FOUNDATION.
- 6) FOOTINGS HAVE BEEN DESIGNED FOR A MINIMUM SOIL PRESSURE OF 1500 PSF, IT WILL BE THE RESPONSIBILITY OF OTHERS TO VERIFY THIS VALUE.
- 7) WHERE REINFORCING BARS ARE SHOWN CONTINUOUS, LAP SPLICE BARS 40 DIAMETERS.
- 8) APPROACHES TO BE A COMMON PLANE WITHIN 1/4".

9 APPROACH THICKNESS MAY BE 10" MINIMUM WHERE ALLOWED BY STATE REGULATIONS


- 10) IF FROST CAN PENETRATE BELOW FOUNDATION, AT LEAST 12 INCHES OF WELL DRAINED, COMPACTED BASE MATERIAL MUST BE PROVIDED UNDER FOUNDATION

(ISSUED BY DATE) S. JOHNSON 02/17/2017		(DRAWN BY DATE) S. JOHNSON 02/17/2017		(REVISION DATE) S. JOHNSON 08/17/2017	
(TREATMENT) NONE		THIS DRAWING AND INFORMATION CONTAINED HEREIN IS THE PROPERTY OF RICE LAKE WEIGHING SYSTEMS INC. HEREINAFTER REFERRED TO AS R.W. IT MAY BE USED ONLY FOR R.W. PROPRIETAL AND ITS CUSTOMER'S ORDER. IT SHALL NOT BE DISCLOSED OR COPIED WITHOUT R.W.'S SPECIFIC WRITTEN CONSENT AND SHALL BE IMMEDIATELY RETURNED UPON REQUEST.		UNLESS OTHERWISE SPECIFIED UNITS TO BE INCHES. ALL THREADS TO BE CLASS 2 ALL DIMENSIONS APPLICABLE AFTER TREATMENT	
(NUMBER OF CRANES) 		TOLERANCES DO NOT SCALE DRAWING UNLESS OTHERWISE SPECIFIED .XX: ± .XXX: ± ✓ ANGLE: ±		(DESCRIPTION) FOUNDATION, CONCRETE SLAB 80' x 11' OTR SERIES TRUCK SCALE	
(MINIMUM CRANE CAPACITY) 		(SCALE) 1:45		(SHEET) 1 OF 3	
(ESTIMATED WEIGHT (POUNDS)) 		(DRAWING TOLERANCES) THIRD ANGLE PROJECTION 		(MATERIAL) 180187	
				(REV) A1	


CONCRETE SCHEDULE			
VOLUME (CUBIC YARDS)			
APPROACHES			8.8
FLOOR			34.7
TOTAL			43.5
MISC. STEEL			
PIT COPING	3 X 3 X 1/4	23 LN. FT	113 LBS

CONCRETE LAYOUT




REVISION				
REV	ECO	DESCRIPTION	INIT	DATE

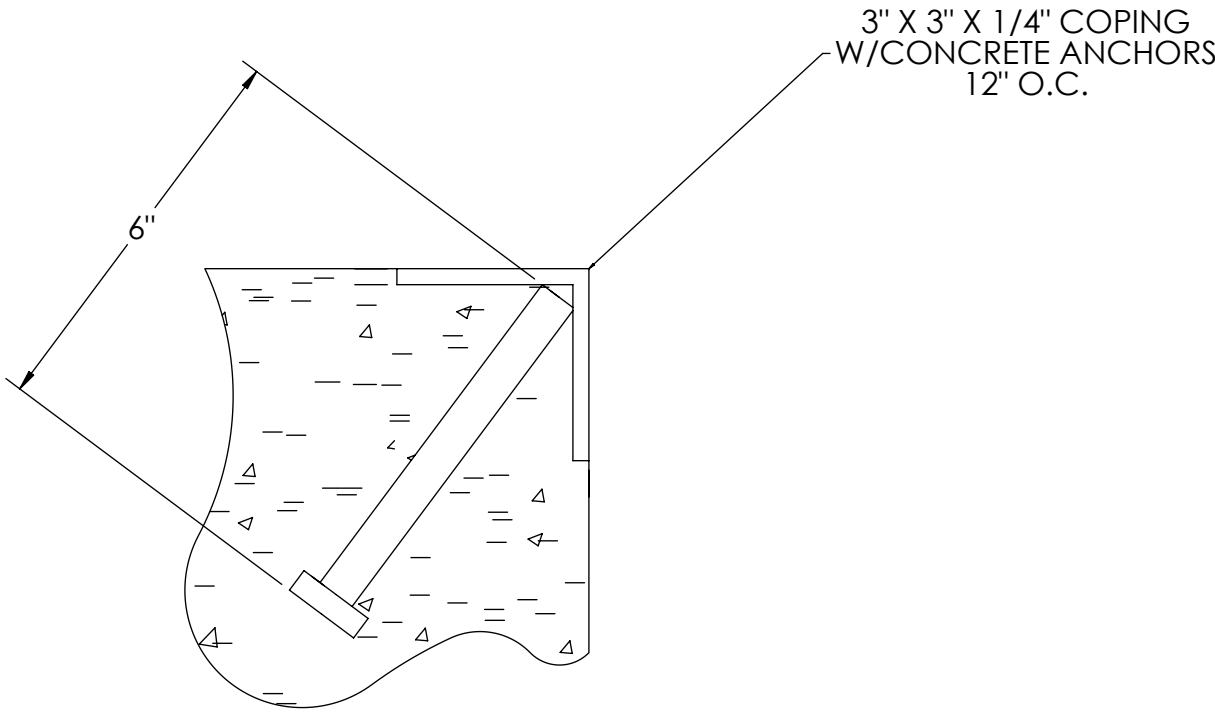

DETAIL C

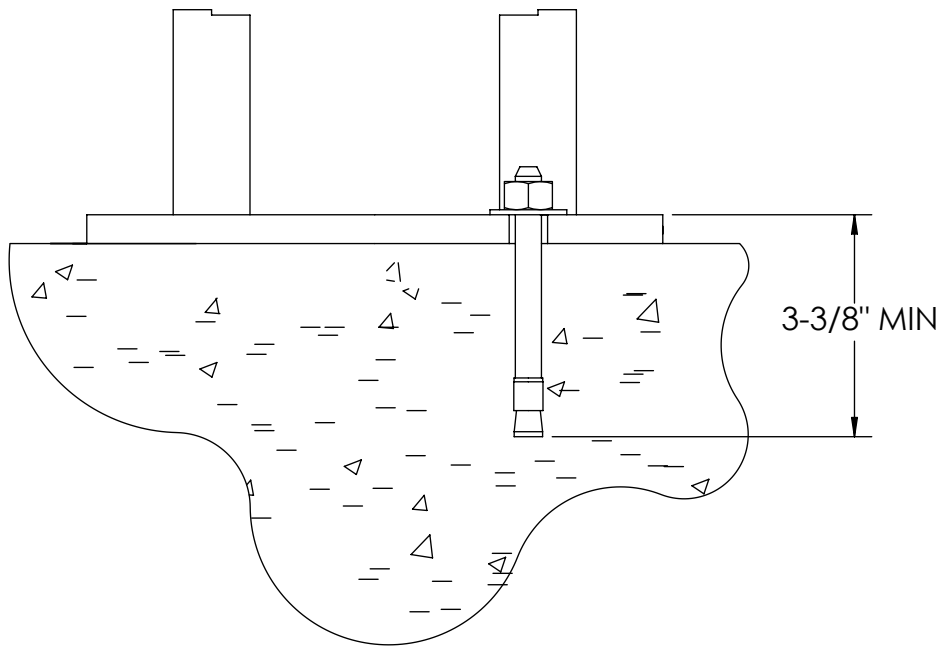

DETAIL D

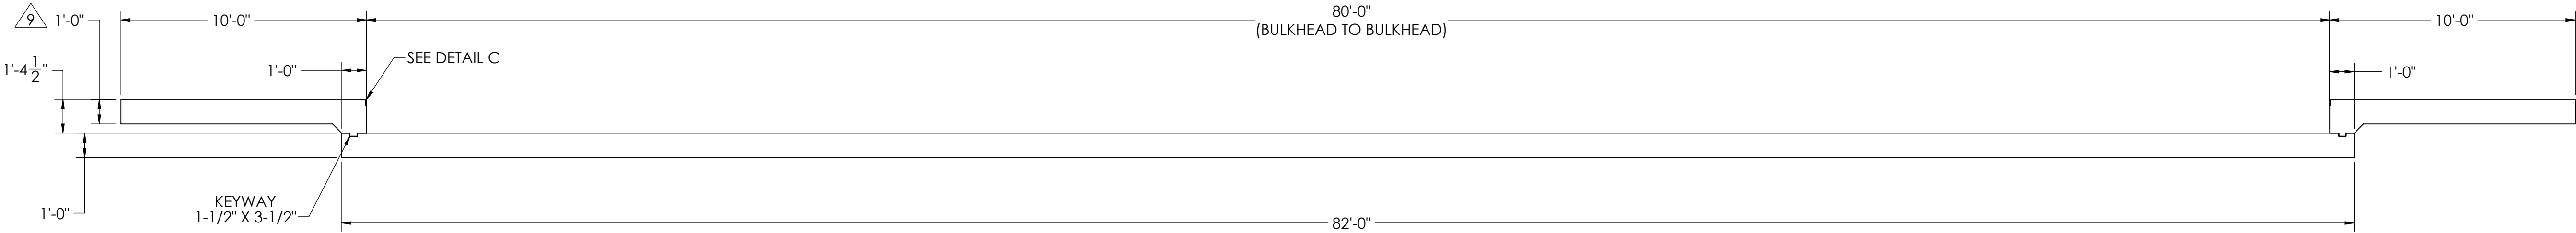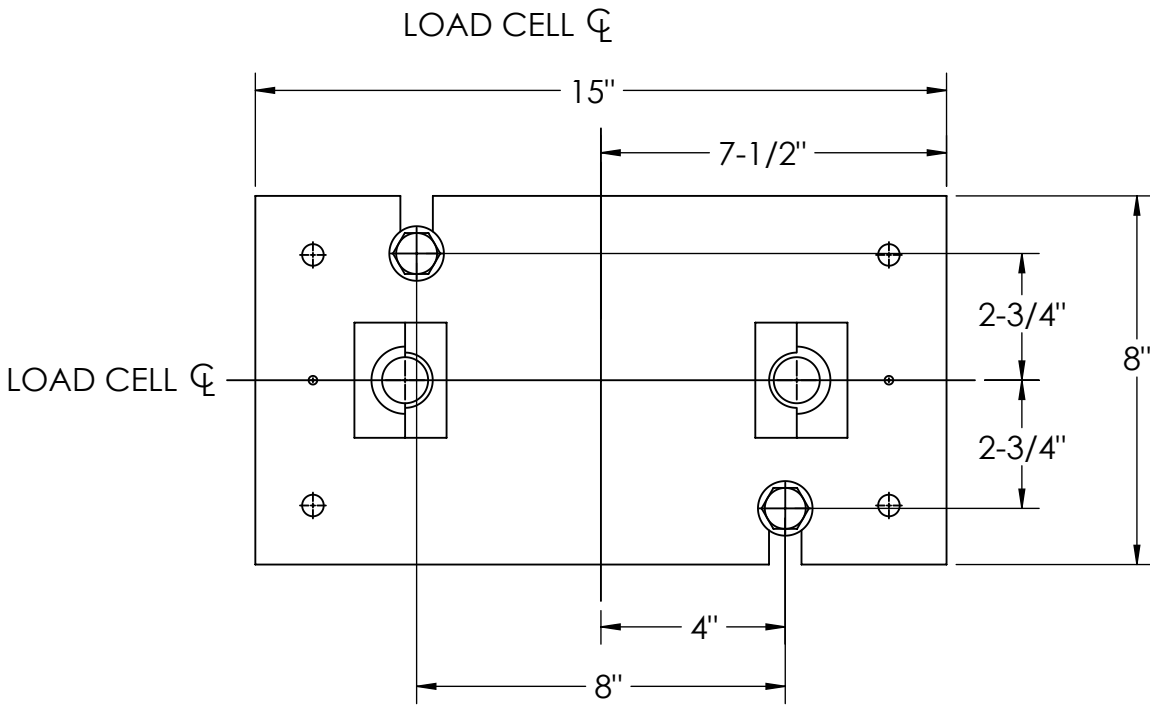

DESIGNED BY: J. JOHNSON S. JOHNSON 02/17/2017	DRAWN BY: J. JOHNSON S. JOHNSON 02/17/2017	FIELD APPROVAL: J. JOHNSON S. JOHNSON 08/17/2017	RICE LAKE WEIGHING SYSTEMS	
TREATMENT NONE	THIS DRAWING AND INFORMATION CONTAINED HEREIN IS AND REMAINS THE PROPERTY OF RICE LAKE WEIGHING SYSTEMS INC. - HEREINAFTER REFERRED TO AS RLWS. IT MAY BE USED ONLY FOR RLWS' PROPOSAL AND/OR ITS CUSTOMER'S ORDERS. IT SHALL NOT BE DISCLOSED OR COPIED WITHOUT RLWS' SPECIFIC WRITTEN CONSENT AND SHALL BE IMMEDIATELY RETURNED UPON REQUEST.		UNLESS OTHERWISE SPECIFIED UNITS TO BE INCHES ALL THREADS TO BE CLASS 2 ALL DIMENSIONS APPLICABLE AFTER TREATMENT	
NUMBER OF CRANES: MINIMUM CRANE CAPACITY: ESTIMATED WEIGHT (POUNDS):	DO NOT SCALE DRAWING SURFACE FINISH ✓	TOLERANCES DRAWING TOLERANCES UNLESS OTHERWISE SPECIFIED .XX: ± .XXX: ± ANGLE: ±	SCALE: 1:45 SHEET: 2 OF 3 THIRD ANGLE PROJECTION	FOUNDATION, CONCRETE SLAB 80' X 11' OTR SERIES TRUCK SCALE 180187 A1

