

NOTES:

1) CONCRETE: f'c = 3000 PSI @ 28 DAYS.

2) REINFORCING STEEL: DEFORMED BARS ASTM A615 GRADE 60,

- 3) STATE AND LOCAL AGENCIES MAY HAVE VARIOUS REQUIREMENTS FOR APPROACH RAMP LENGTH, PITCH, AND FOR CLEAN OUT HEIGHT. PLEASE CHECK WITH ALL AGENCIES PRIOR TO CONSTRUCTION.
- 4) MONOLITHIC POUR OF SLAB AND APPROACHES IS ALLOWED, AT CONTRACTOR'S DISCRETION.
- 5) DEVELOP AND MAINTAIN SITE GRADES WHICH WILL RAPIDLY DRAIN SURFACE AND ROOF RUN-OFF AWAY FROM FOUNDATION.
- 6) FOOTINGS HAVE BEEN DESIGNED FOR A MINIMUM SOIL PRESSURE OF 1500 PSF, IT WILL BE THE RESPONSIBILITY OF OTHERS TO VERIFY THIS VALUE.
- 7) WHERE REINFORCING BARS ARE SHOWN CONTINUOUS, LAP SPLICE BARS 40 DIAMETERS.
- 8) APPROACHES TO BE A COMMON PLANE WITHIN 1/4".


APPROACH THICKNESS MAY BE 10" MINIMUM WHERE ALLOWED BY STATE REGULATIONS 10) IF FROST CAN PENETRATE BELOW FOUNDATION, AT LEAST 12 INCHES OF WELL DRAINED, COMPACTED BASE MATERIAL MUST BE PROVIDED UNDER FOUNDATION


DETAILS


REVISION				
REV.	ECO	DESCRIPTION	INIT	DATE
A		ENGINEERING RELEASE	SPJ	01/22/2019

ESTIMATED WEIGHT (POUNDS)	ANGLE: ±	THIRD ANGLE PROJECTION P/N	194045	REV A
	DRAWING UNLESS OTHERWISE SPECIFIED	1:70 Sheet 1 OF S	3 MATERIAL	
	TOLERANCES		ON, CONCRETE SLA SERIES TRUCK SCA	
NONE	THIS DRAWING AND INFORMATION CONTAINED HEREIN, IS AND REMAINS THE PROPERTY OF RICC LAKE WEIGHING SYSTEMS INC., HEREINAFTER REFERRED TO AS RLWS. IT MAY BE USED ONLY FO RLWS' PROPOSAL AND/OR ITS CUSTOMERS' ORDERS. IT SHALL NOT BE DISCLOSED OR COPIE WITHOUT RLWS SPECIFIC WRITTEN CONSENT AND	ALL THREADS TO BE INCHES ALL THREADS TO BE CLASS 2 ALL DIMENSIONS APPLICABLE AFTER TREATMENT		STEMS
DESIGNED BY / DATE S.JOHNSON 01/22/2019	DRAWN BY / DATE S.JOHNSON 01/22/2019	PEER APROVAL/ DATE S.JOHNSON 01/22/2019		


CONCRETE SCHEDULE					
		VOLUME	VOLUME (CUBIC YARDS)		
	APPROACHES	5	11.2		
	FLOOF	42.7			
	PIERS	0.4			
	ΤΟΤΑΙ	54.3			
MISC. STEEL					
PIT COPING	3 X 3 X 1/4	28 LN .FT	137 LBS		

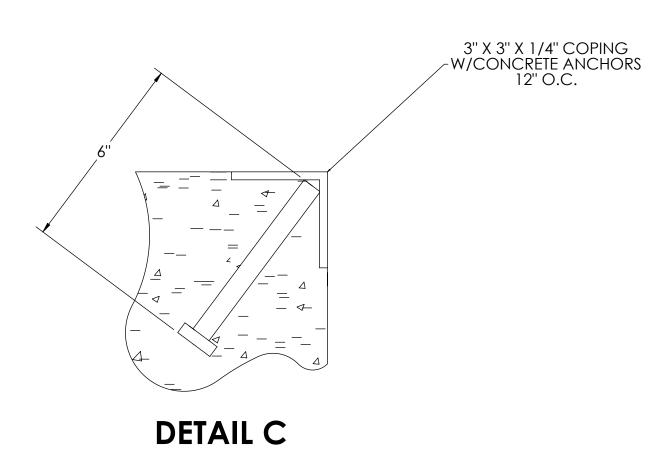

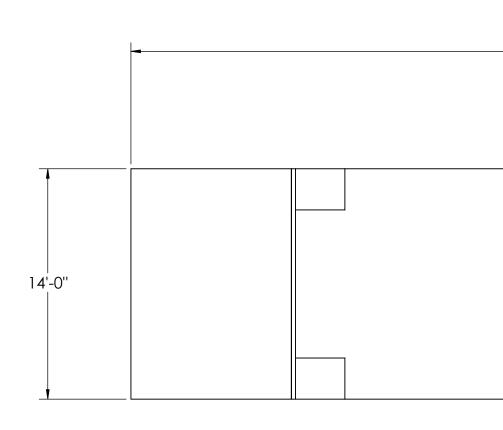

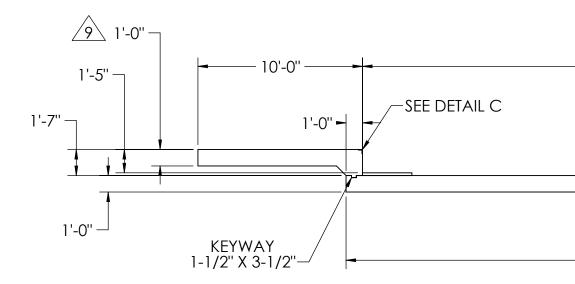



CONCRETE LAYOUT

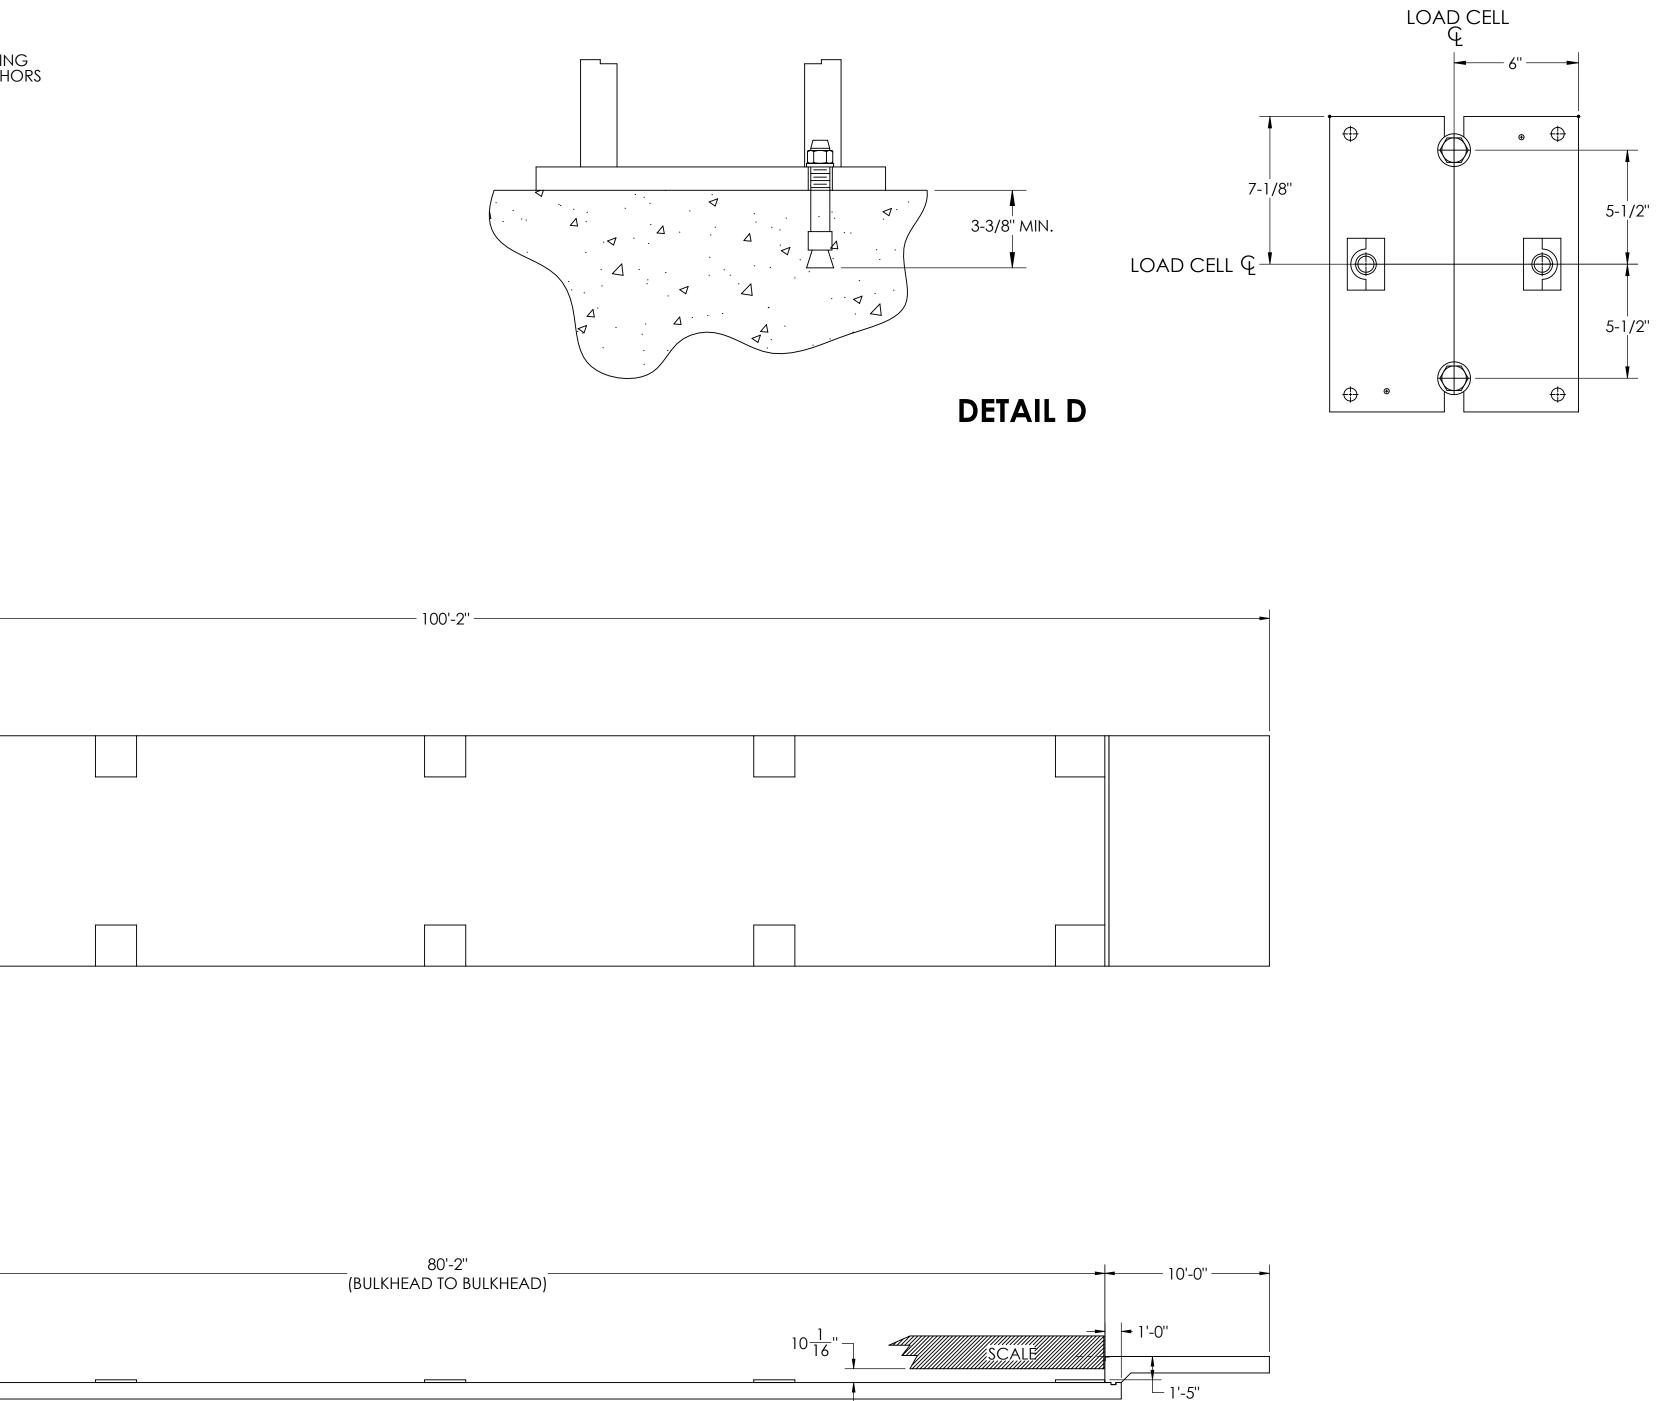

– 82'-2'' —

DESIGNED BY / DATE S.JOHNSON 01/22/2019	DRAWN BY / DATE S.JOHNSON 01/22/2019	peer aproval/date S.JOHNSON 01/22/2019	
TREATMENT	THIS DRAWING AND INFORMATION CONTAINED HEREIN, IS AND REMAINS THE PROPERTY OF RICE LAKE WEIGHING SYSTEMS INC., HEREINAFTER REFERRED TO AS RLWS. IT MAY BE USED ONLY FOR RLWS' PROPOSAL AND/OR ITS CUSTOMERS' ORDERS. IT SHALL NOT BE DISCLOSED OR COPIED	ALL THREADS TO BE CLASS 2 ALL DIMENSIONS APPLICABLE AFTER TREATMENT	RICE LAKE' WEIGHING SYSTEMS
	WITHOUT RLWS SPECIFIC WRITTEN CONSENT AND SHALL BE IMMEDIATELY RETURNED UPON REQUEST. TOLERANCES DO NOT SCALE DRAWING TOLERANCES	FOUNDATIO SR S	n, concrete slab 80' x 11' eries truck scale
	AWING UNLESS OTHERWISE SPECIFIED	1:70 Scale 2 OF 3	MATERIAL
	\sim .XXX: ± \sim ANGLE: ±		194045 REV A

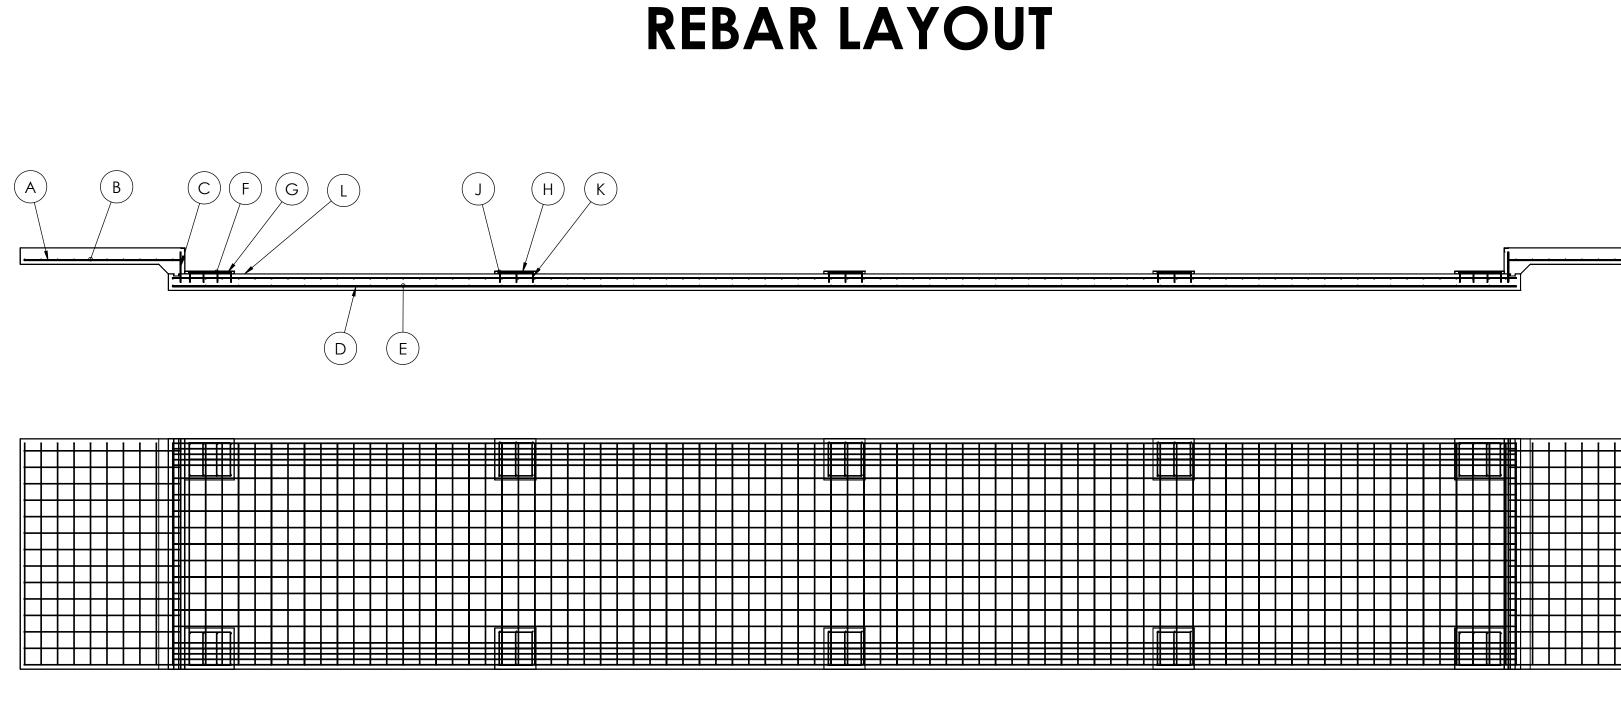

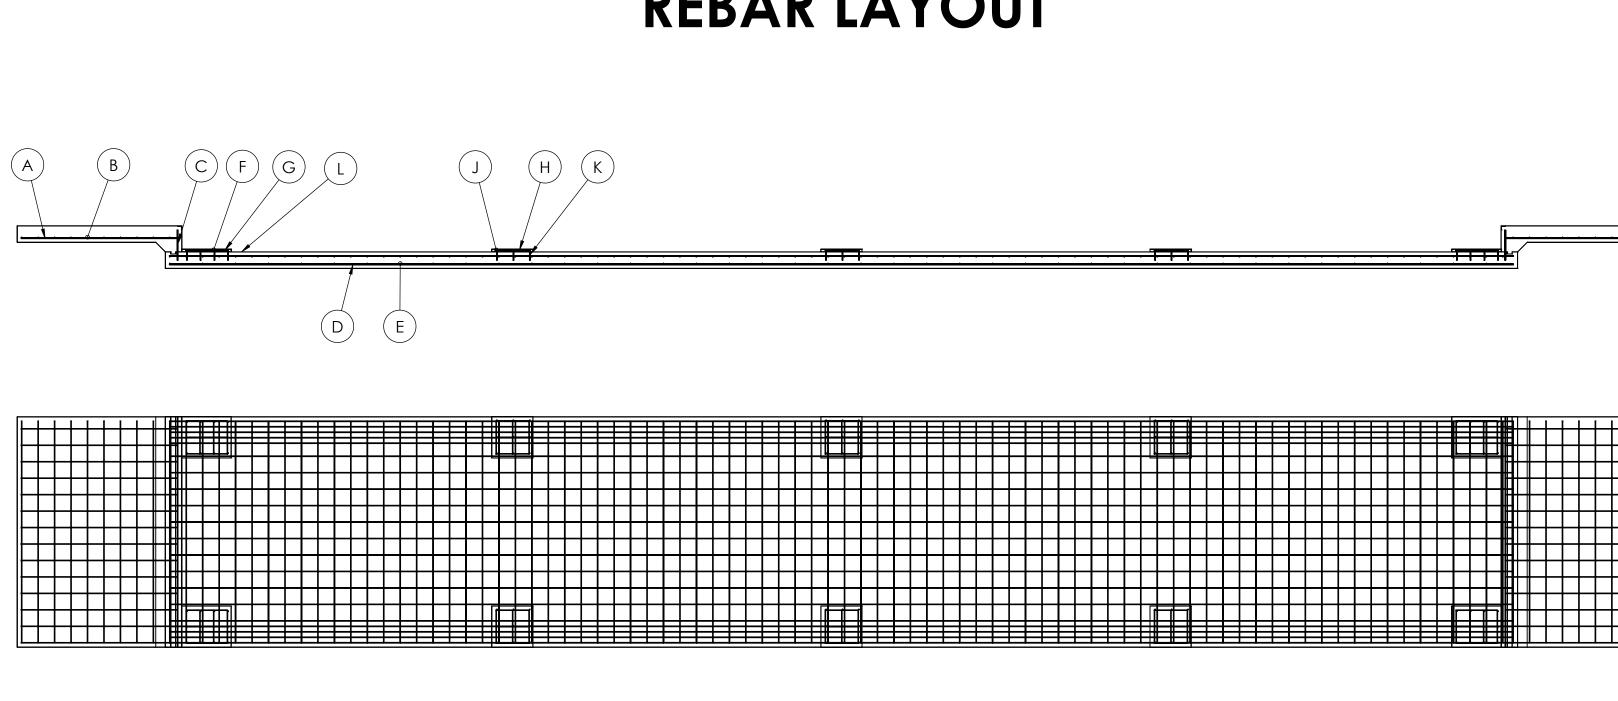

	MATERIAL REQUIRMENTS					
	REBAR SCHEDULE					
BAL. NO.	QUANTITY	LENGTH (FT-IN.)	DESCRIPTION	WEIGHT		
А	28	9' 6"	# 4 @ 12 O.C.	178		
В	20	13' 6"	# 4 @ 12 O.C.	180		
С	28	1' 8 1/2"	# 4 @ 12 O.C.	32		
D	35	81' 8"	# 4 AS SHOWN	1909		
E	123	13' 6"	# 4 AS SHOWN	1109		
F	16	2' 0"	# 4 @ 10 O.C.	21		
G	12	2' 6"	# 5 @ 12 O.C.	31		
Н	18	2' 0"	# 5 @ 12 O.C.	38		
J	18	2' 0"	# 5 @ 12 O.C.	38		
К	36	0' 7"	# 5 @ 12 O.C.	22		
L	32	0' 7"	# 5 @ 10 O.C.	19		
TOTAL WEIGHT OF REBAR (LBS.)				3578		
TOTAL LENGTH OF REBAR (FT.)				5276		

